

CERTIFICATE OF INVESTIGATION STUDY

STUDY OF VERFICATION OF THE EFFICIENCY OF ONE DEVICE ON SARS-COV2 BY NO GLP VIRAL CLEARANCE STUDY (FIO)

Study number: 1174/01c2

Study report for:

Sponsor: Panasonic Ecology System Co Ltd


4017 Shimonakada, Takarai-cho,
Kasugai-shi, Aichi
486-8522
Japan

Submitted by:

Test Facility: TEXCELL

Test facility management: Boisson Bruno

Genavenir 5
1 rue Pierre Fontaine
91058 Evry cedex
France

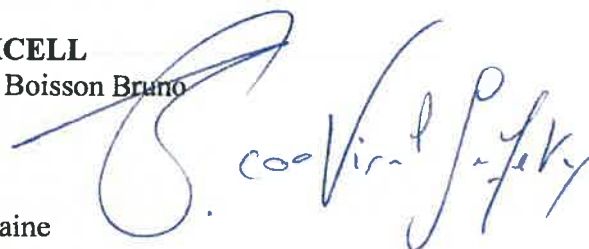

In Panasonic conditions of use:

An inactivation and reduction titer of more 4 Log (99.99%) of Sars-Cov-2 in 8 hours was demonstrated in a 6.7m³ area

Texcell

Immeuble Genavenir 5

1 rue Pierre Fontaine

F-91058 EVRY Cedex

Téléphone : + 33 (0)1 60 91 33 10

Télécopie : + 33(0)1 64 93 33 24

www.texcell.com

Evidence of the suppressive effect on novel coronavirus by the active chlorine component of volatilized aqueous hypochlorous acid solution from ziaino

■ Purpose

To verify the suppressive effect on novel coronavirus by the active chlorine component of hypochlorous acid aqueous solution volatilized from ziaino

■ Test Facility

Texcell (France) *Report No: 1174/01 c2

■ Condition


Verification device: Ziaino (F-JML30)

- The rotary sterilizing filter is permeated with a hypochlorous acid aqueous solution having a pH of about 8.5 and a concentration of about 10 mg/L
- Active chlorine component is volatilized by applying a constant wind ($3 \text{ m}^3/\text{min}$) to the rotary sterilizing filter.
- Product operation
 - Airflow: Strong
 - Electrolytic Strength: Strong (Electrolysis inside the product)

■ Verification Method

- A gauze coated with the novel coronavirus (SARS-CoV -2) is set in the test space
- Virus infectivity titer is measured to calculate the inhibition rate.
- Exposure time: 2, 4, 8 hours
 - Exposure <Verification device installed>
 - Unexposed <No verification device installed>
- Test space: 6.7 m^3 / 222.4 ft^3
 - Exposure ... 6.7 m^3 *No ventilation
 - Unexposed (natural damping) ...in safety cabinet *No ventilation


■ Test Space

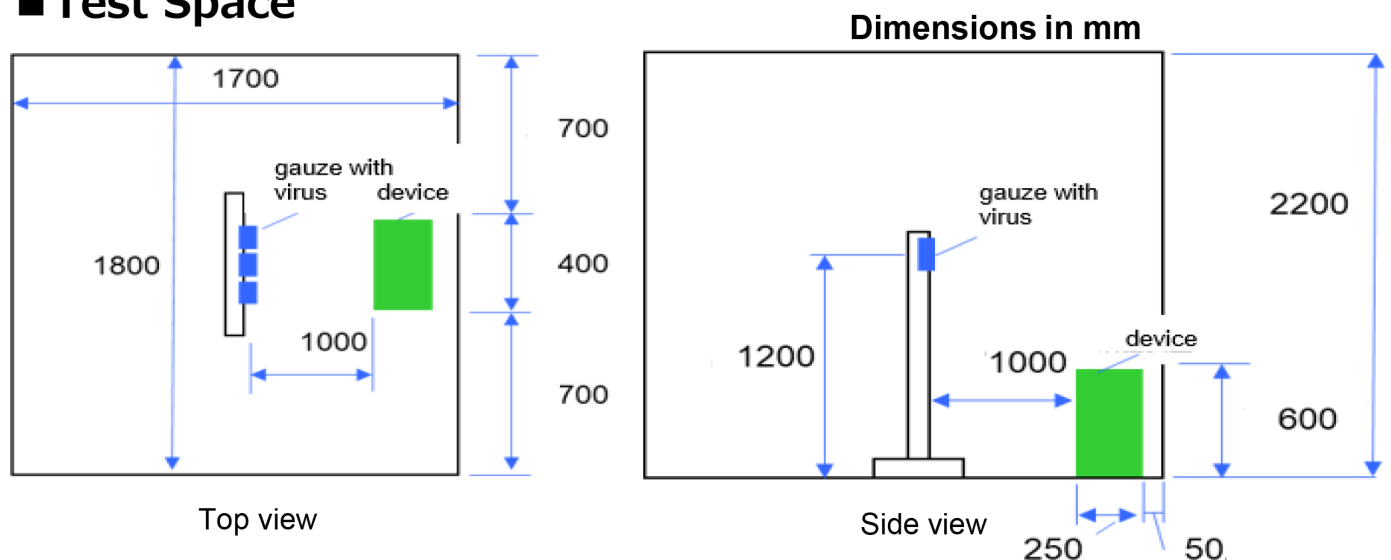

Evidence of the suppressive effect on novel coronavirus by the active chlorine component of volatilized aqueous hypochlorous acid solution from ziaino

Results

Time	2H	4H	8H
Suppressive Effect	91.48%	97.86%	>99.99%

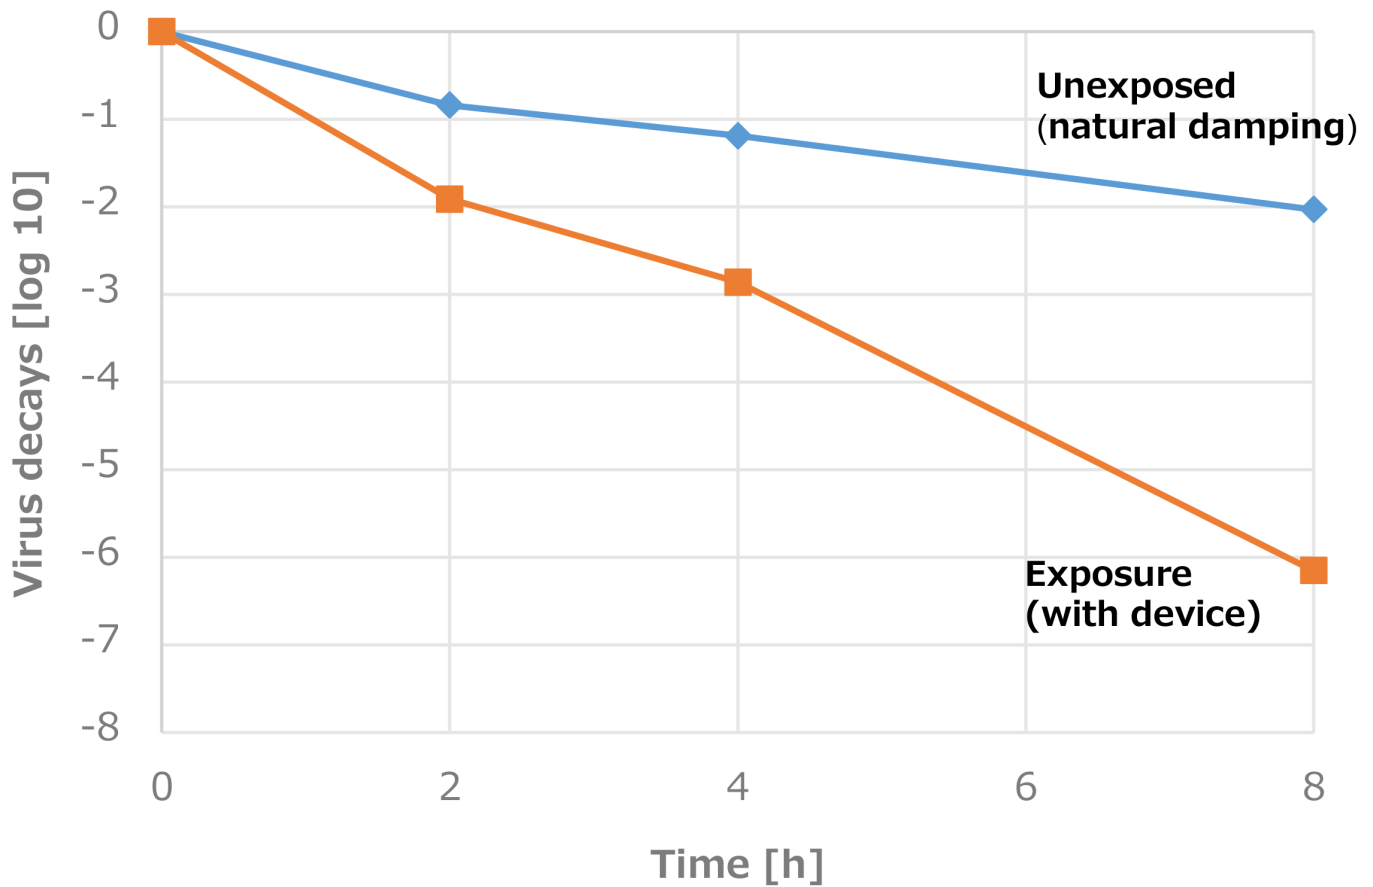

The novel coronavirus, which was attached by the active chlorine component of hypochlorous acid aqueous solution volatilized from the verification device, demonstrated a suppressive effect of more than 99.99% in 8 hours in a space of 6.7 m³.